

Pre-Con 3 Automactic Suction Valve

Typical friction loss based on actual flow test. Test facilities were designed to simulate fire flow conditions. Flows that you obtian may vary

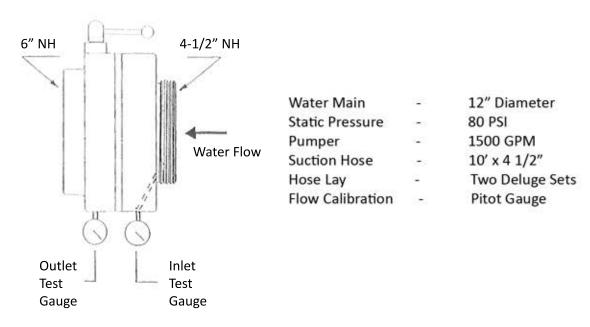

Friction Loss

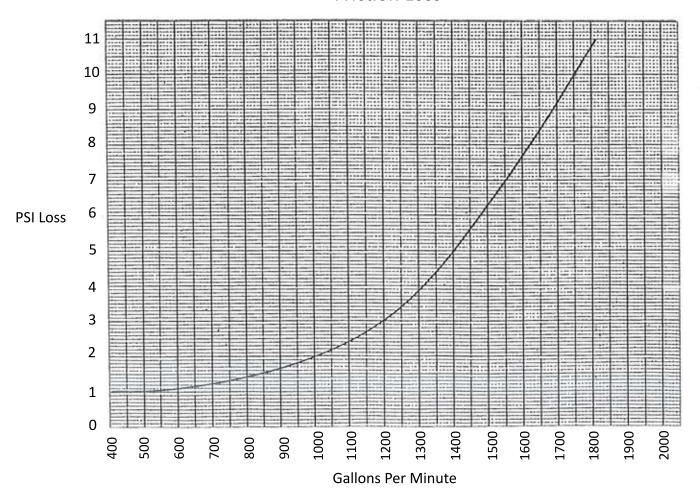

Note: Add 2 psi for spring resistance in "free floating" position.